



Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com

A large green rectangular area with a white border. Inside, the text 'DUBAI SWORO CASE STUDY' is written in large, white, bold, sans-serif capital letters. Behind the text is a faint, light-colored image of the Dubai flag, which features Arabic calligraphy and a sword. Below the text, a horizontal white line is partially visible, followed by a faint image of a sword.

DUBAI SWORO CASE STUDY



PRO AT FLUID CONTROL



valveiT[®]

Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com



The **Doha SWRO Plant** produces 125,000 m³/day of desalted water. The project consists on generating 1 MGD desalinated water and 5MW of energy power generation. Facilities include diesel power generation plant and power distribution, Reverse Osmosis desalination plant and a transmission pipeline to Doha, seawater intake structure, water tower, control buildings, laboratories, office/administration building, mosque and housing facilities.





valveiT®

Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com



The client asked for **valveiT support** concerning problems occurred on super duplex pneumatic butterfly valves. In details, damages referred to:

- **Unusual corrosion** occurring on **internal valve sides** of the valveiT's super duplex pneumatic butterfly valves. Although the high-corrosive environment of the desalination plant, valveiT super duplex valves were built to face against this critical condition thanks to the specific use and chemical properties of the manufacturing valve material.





valveIT®

Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com



- **Super Duplex**, also known as **SAF 2507** or **Super Duplex 2507** with **UNS S32750** and **UNS S32760** (1.4410 / 1.4501 / f53 / f55 / 2507), is an high alloy duplex stainless steel with a **PREN** value of **min. 40**. Super Duplex S32750 and Super Duplex S32760 has 25% chromium (25Cr Duplex), 4% molybdenum and 7 % nickel (X2CrNiMoN25 7 4). This high molybdenum, chromium and nitrogen content causes **high resistance** to chloride pitting and crevice corrosion attack, while the duplex structure provides 2507 with exceptional resistance to chloride stress corrosion cracking






valveIT Intervention:

- **valveIT Technical Staff**, basing on its previous experience on desalination project and evaluating chemical and technical data coming from the client, came to the problem potential cause by noting the **circular border** of the corrosion track. As shown by the provided photo, the problem referred to valve parts which were not in contact with high-corrosive fluids flowing inside the plant's pipes: **galvanic corrosion** didn't affected the valve internal super duplex disc and parts.



valveIT®

Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com

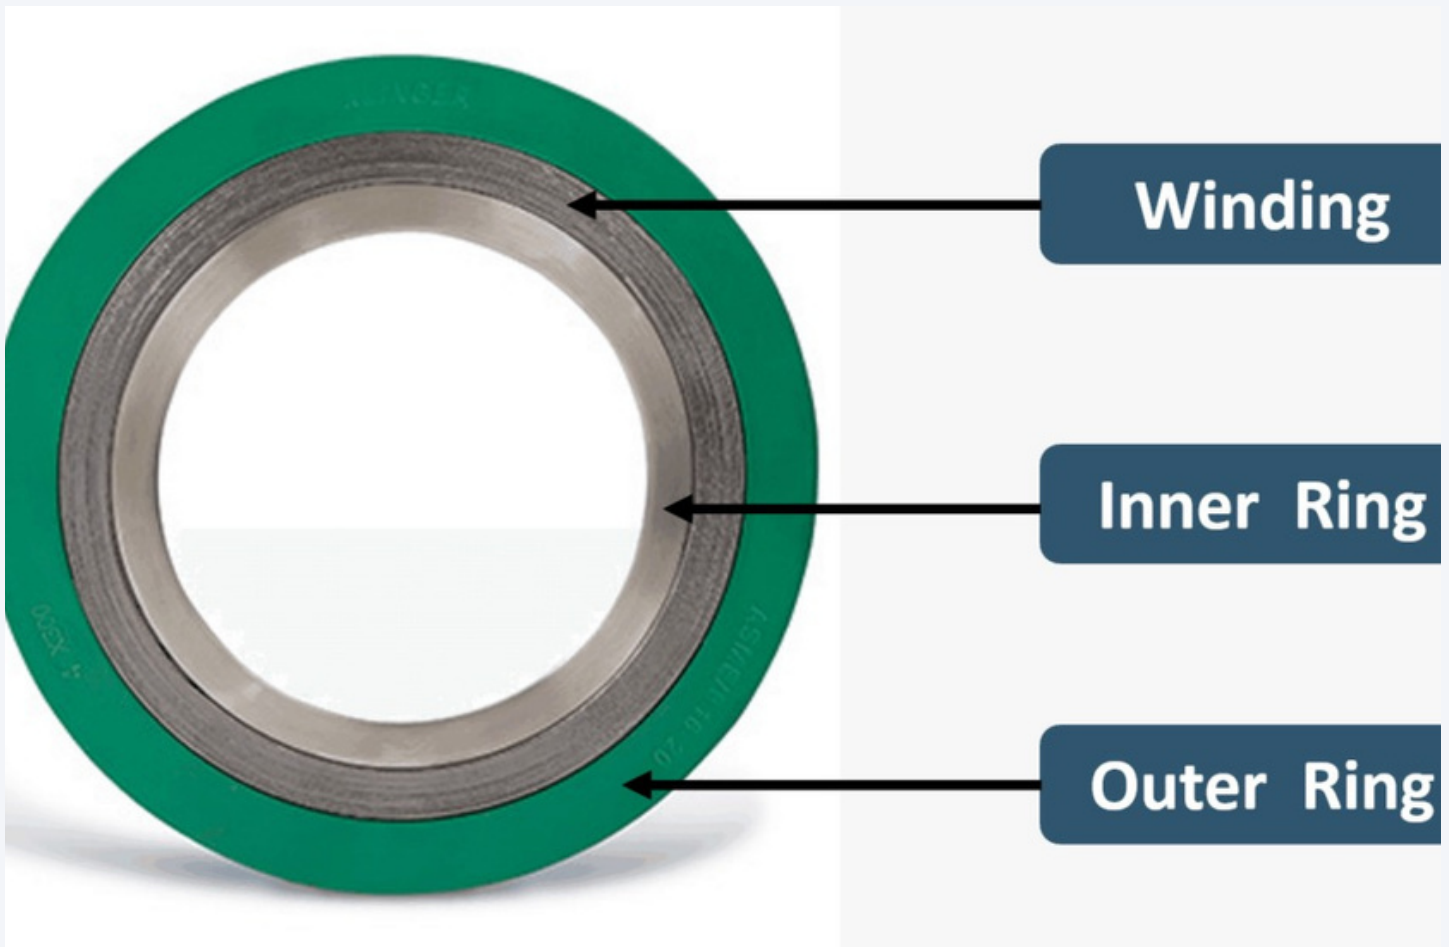

- Basing on the previous observation, valveIT asked to the client material composition of the gasket (supplied by other manufacturers) which had been installed at the Duba SWRO plant in order to guarantee the seal of the piping system. Once obtained the data, valveIT discovered that the applied gaskets were made of the following material scheme:

1. **WINDING:** Graphite
2. **OUTER RING:** Super Duplex SS32750
3. **INNER RING:** Super Duplex SS32750



valveIT[®]

Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com



- Due to the presence of the gasket's graphite winding, the chemical corrosion had been ascribed by valveIT to the **different electrochemical material behaviour** of the super duplex valve and the gasket's graphite winding. To summarize, there had been significant **crevice corrosion** failures of the super-duplex stainless steel valves associated with graphite gaskets: these failures usually happen in chlorinated systems for which the corrosion potentials are particularly high and beyond the range for which a benefit from graphite could be anticipated.





valveIT[®]

Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com



- The material reaction happening on the **low-pressure valve side** connected to the gasket was caused by the fact that high chlorinated seawater passed through the gasket's inner ring and touched the graphite spiral wound creating galvanic corrosion.[1]


[1] See highlighted section of the attached technical paper





valveIT[®]

Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com

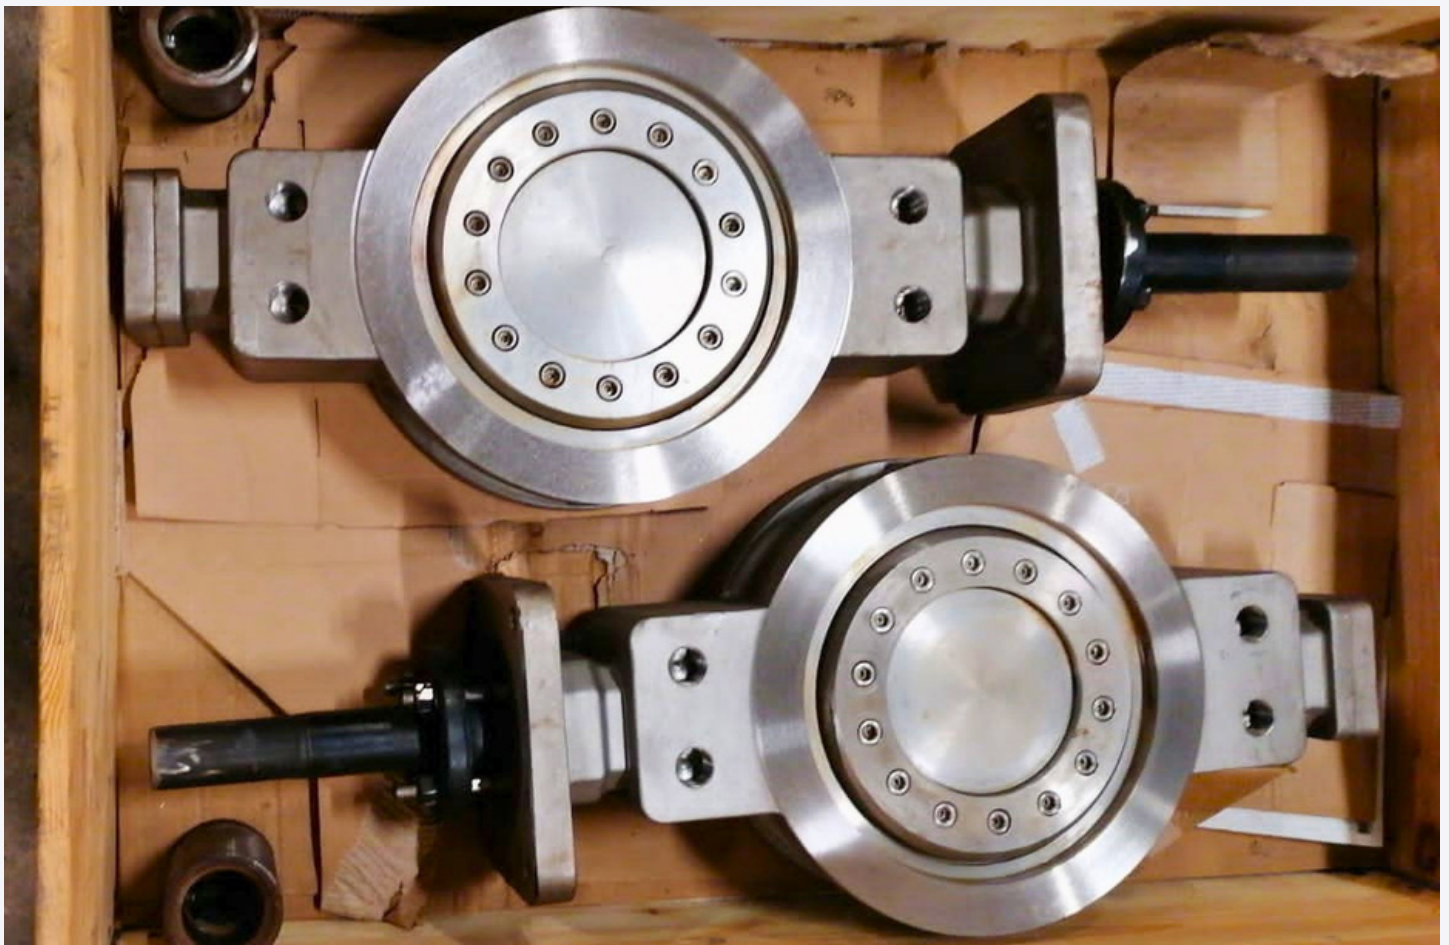

- In order to solve the occurred issue, valveIT technical staff arranged its intervention according to the following working schedule:

1. **Grinding/polishing of the damaged surface**
2. **Grinded Surface preparation**
3. **Welding overlay Super Duplex**
4. **Machining of welded overlay**
5. **Phonographic spiral groove machining**
6. **Pressure test**



FACTORS AFFECTING GASKET SELECTION FOR STAINLESS STEELS IN SEAWATER

R Francis and G Byrne
Weir Materials & Foundries
Park Works
Newton Heath
Manchester M40 2BA
UK

ABSTRACT

High alloy stainless steels, such as superduplex and 6%Mo, have been extensively used for seawater cooling systems and in reverse osmosis desalination plants. From time to time corrosion has been observed at flange faces that is not attributable to poor quality material or excessively severe operating conditions. Over the last fifteen years there have been studies looking at corrosion of flanged joints. Some have investigated flange materials, while others have looked at different gasket materials. The present paper reviews the published data and presents some field experience from the authors' company. These are combined to present some recommendations on combinations to be avoided and the best choice of suitable gaskets for systems operating at different pressures.

Keywords: seawater, crevice corrosion, stainless steels, gaskets.

INTRODUCTION

Stainless steels have been increasingly used for seawater cooling systems, particularly the higher alloy materials, such as superduplex and superaustenitic. The main concern with stainless steels in seawater is crevice corrosion and one of the main creators of crevices is a flanged joint. Most flanges are designed in accordance with ASME B16.5 or an equivalent national standard. Stainless steels for flanges conform to ASTM A182 or an equivalent standard. Although there is a range of flange designs in use, by far the most common is the raised face weld neck flange. The gasket fits on the raised face, which is quite wide and at first glance it might be thought that this will create a tight, deep crevice, with a potentially high risk of corrosion. However, the raised face has a spiral or "gramophone" groove machined across it. This means that the face creates a series of relatively shallow, tight crevices, linked by much broader areas of a similar depth. This is a much less aggressive crevice arrangement. Less attention has been paid to the selection of the gasket material. It is clearly desirable to select gasket materials that will not exacerbate crevice attack and there is published data to show that some gasket materials create tighter and more aggressive crevice conditions than others. This paper reviews published data and also some service failures. It also makes recommendations on the most suitable gasket materials, both for normal low pressure (~10bar) cooling systems and the high pressure systems (~70bar) used in RO desalination plants.

ALLOYS

Before discussing gaskets we need to be aware of which stainless steels these are being used with. Low alloy stainless steels, such as 316L (UNS S31603) will suffer crevice corrosion in seawater and all waters containing more than ~1,000mg/l chloride¹. Even higher alloy stainless steels, such as 904L (UNS N08904) and 22% Cr duplex (UNS S31803), suffer crevice corrosion in ambient temperature seawater². Only alloys with a pitting resistance equivalent number (PREN) greater than 40 (where $PREN = \% Cr + 3.3 \times \% Mo + 16 \times \% N$) have been shown to resist crevice corrosion in ambient temperature seawater². This has become enshrined in standards such as the Norwegian oil and gas NORSOK document³. This essentially covers the superduplex and 6% Mo austenitic stainless steels. The nominal composition of these alloys is shown in Table 1. Both of these alloy types are covered by several UNS numbers and some variants of the 6% Mo alloys also contain copper, while some of the superduplex alloys also contain copper and/or tungsten.

LABORATORY TESTING

Traditionally, compressed asbestos fibre (CAF) gaskets were used in seawater cooling systems and these gave few problems. However, with the banning of CAF gaskets a wide variety of materials have been offered for use in gaskets. These include synthetic rubbers, such as neoprene, synthetic fibres, such as aramid, and PTFE. These have been evaluated in a number of laboratory tests.

Kain⁴ tested a variety of gasket materials with 316L flanges in natural seawater in the temperature range 25° to 32°C for 28 days. His results are summarised in Table 2. Although crevice corrosion of 316 would be expected under these conditions, three gasket materials did not have any crevice corrosion on the flanges. In addition, three more materials gave only shallow attack. In contrast, the remaining five materials all had very deep attack on the flanges. One thing to remember with flanges conforming to ASME B16.5 is that the gasket face has a spiral “gramophone” groove machined on it. This means that instead of there being a deep, tight crevice across the whole of the gasketed face, it is a series of shallow, tight crevices connected by wider, shallower regions. This permits diffusion from the less tight regions, thus retarding the concentration of chloride in crevices that is the precursor to the initiation of crevice corrosion⁵.

Following a series of failures of 6% Mo stainless steel flanges in the North Sea, Rogne et al⁶ examined some weld overlays for 6% Mo to improve the resistance to crevice corrosion resistance. At the same time they examined two gasket materials, PTFE and aramid fibre. The tests were carried out at +600mV SCE, simulating that in chlorinated seawater, and the threshold temperatures for crevice corrosion were determined. The results are summarised in Figure 1. The results show that PTFE creates a much more severe crevice than aramid fibre, particularly for the nickel alloys. It is interesting that an alloy 625 (UNS N06625) weld overlay was inferior to a wrought 6% Mo flange with the same gasket material. This demonstrates that a material with a high resistance to crevice corrosion as a wrought alloy may not necessarily confer equivalent resistance when used as a weld overlay.

Rogne et al carried out a more extensive series of tests on 6% Mo material with a range of gasket materials⁷. The results, in Figure 2, show that higher critical crevice temperatures (CCT) were obtained for aramid fibre compared with both PTFE and POM. The authors showed that the gaskets giving the highest CCT values also absorbed the most water. This meant there was more water within a gasket that could diffuse into the tightest regions to delay the onset of crevice corrosion. In addition, materials such as PTFE can deform to fit the flange face, creating tighter crevices.

One factor that is often discussed is that of gaskets containing graphite. Graphite is very noble and is a very efficient reducer of dissolved oxygen, which is the cathodic reaction in seawater systems. Turnbull⁸ investigated the properties of graphite and showed that up to about +400mV SCE, coupling high alloy stainless steel to graphite should retard the reduction of pH in the crevice. This possible beneficial effect of graphite has not been demonstrated in practice. Kain⁴ tested 316 with graphite gaskets and reported deep attack, but this alloy suffers crevice corrosion at potentials around +400mV SCE, while higher alloy stainless steels are resistant at this potential. Turnbull also

pointed out⁸ that at the potentials achieved in chlorinated seawater (+600mV SCE) the graphite will stimulate acidification and thus exacerbate crevice corrosion. As most stainless steel seawater systems are chlorinated, this means that graphite-containing gaskets will increase the risk of crevice corrosion.

Martin et al⁹ conducted tests on alloy 625 (UNS N06625) in seawater at a potential of +300mV and 65°C, using fluoropolymer (FKM) gaskets to create crevices. In the first test severe crevice corrosion occurred. In the second test a different batch of the same gasket material was used and no crevice corrosion occurred. The reason for the superior performance of the alloy 625 in the second test was judged to be because of a deposit in the crevices from the gasket material. This was identified as a talc-related compound from a mould release agent used during the manufacture of the gaskets. This compound gave better crevice corrosion to alloy 625 compared with higher alloy nickel-base materials creviced with the original fluoropolymer gasket material. Proper characterisation of this compound may offer a method of reducing the risk of crevice corrosion in the future.

HIGH PRESSURE GASKETS

Most seawater cooling systems are rated up to 10 bar, but the high pressure section of an RO desalination plant operates at pressures from 65 bar to 100 bar. At these pressures conventional gaskets are not suitable to retain the pressure at flanged joints. It is common to use metal gaskets either as a "V" or spirally wound. The most common type of these gaskets utilise 316 stainless steel or alloy 400 (UNS N04400). Both alloys suffer severe attack in crevices in seawater, and this can lead to attack on high alloy stainless steels adjacent to them^{2, 10}. The reason for this is that when 316 stainless steel (or alloy 400) corrodes, the pH of the localised water drops sharply. The solution can eventually become sufficiently acid (pH<1) to promote attack on both super austenitic stainless steels¹⁰ and superduplex stainless steels².

Other metals are also used for spiral wound gaskets, but only those that are seawater resistant and galvanically compatible with high alloy stainless steel should be used. Table 3 shows some alloys commonly used for high pressure gaskets and which ones are suitable for use with high alloy stainless steel in seawater¹¹. The choice will depend on price and availability.

Graphite is sometimes used as a filler in spiral wound gaskets. Provided it never contacts seawater, it should not cause a corrosion problem. If the windings are damaged prior to installation, so that the graphite is exposed to seawater, then there is a possibility of galvanic corrosion of the flange faces.

Another method of coupling in high pressure systems is the Victaulic-type joint. In this, both pipes have a square cut groove on the outside of the pipe, some 15mm or so from the end. A rubber boot slips over both pipe ends and it is held in place with a clamp, as shown in Figure 3. The sealing boot is usually made of a synthetic rubber. The crevice created by such a seal is relatively tight and deep and it has caused corrosion of low alloy materials, such as 316L, in seawater, as shown in Figure 4¹². Crevice corrosion with this type of joint and high alloy stainless steels is rare and corrosion is usually due to poor heat treatment of the stainless steel.

SERVICE EXPERIENCE

Over the last 15 years a number of problems with leakage at flanges due to corrosion have been reported for 6% Mo austenitic and superduplex stainless steels. A few of these have been due to metallurgical problems, such as sigma phase due to incorrect heat treatment¹³. However, more have concerned the use of graphite-containing gaskets in chlorinated seawater service.

Strandmyr and Hagerup reported problems with graphite-containing gaskets on 6% Mo stainless steel flanges on several North Sea platforms¹³. The problems were solved by re-machining the flange face and changing to neoprene gaskets. Shrive¹⁴ reported a similar problem on the Rob Roy/Ivanhoe platform, with superduplex stainless steel. Again the problem was solved by re-machining the flange faces and changing, this time, to synthetic fibre gaskets. The author has also

seen the problem in superduplex flanges on the seawater feed piping at an RO desalination plant in the Middle East. Figure 5 shows the typical appearance of the attack.

There have been a number of problems reported with spiral wound gaskets, where the metal was not compatible with high alloy stainless steel in seawater. Strandmyr et al¹³ reported problems with 316L stainless steel gaskets. The authors have seen problems with 316L and alloy 400 (UNS N04400). Amon et al¹⁵ reported failures of superduplex flanges joined with both alloy 825 (N08825) and alloy 718 (N07718) gaskets in natural seawater. The solution to these problems has been to re-machine the flange faces and change to synthetic fibre or neoprene gaskets for low pressure systems. For high pressure systems, where a spiral wound gasket is essential to ensure a tight seal, a gasket made from one of the compatible alloys in the left hand column of Table 3, has been used.

PTFE has not often been used for gaskets in seawater systems and reported cases of failures are rare. Figure 6 shows corrosion of a superduplex stainless steel flange from on RO desalination plant where PTFE had been used. In this case, the gasket was a 316L spiral wound gasket coated in PTFE, because the joint was in the high pressure section (70 bar). A change was made to a compatible metal gasket with no coating.

It must be remembered that not all corrosion at flanged joints is due to poor gasket selection. Corrosion can also be caused by over chlorination or too high a seawater temperature. Francis and Byrne¹⁶ showed that the temperature and chlorine limits are linked and they presented recommendations for superduplex stainless steel based on a combination of laboratory testing and service experience (Table 4). Corrosion problems due to incorrect material heat treatment were mentioned above.

RECOMMENDATIONS

Based on the foregoing testing and service experience, the following recommendations are made for gaskets for high alloy stainless steels in seawater.

A. Low Pressure Systems (up to 10 bar).

1. Avoid the use of PTFE or graphite loaded gaskets.
2. Use gaskets made of synthetic rubber, rubber bonded aramid or synthetic fibre.

B. High Pressure Systems (10 bar to 100 bar)

1. Avoid PTFE coated gaskets.
2. Graphite- containing gaskets are acceptable provided the graphite is sealed from the seawater and is never wetted.
3. Only metals compatible with high alloy stainless steel should be used for spiral wound gaskets.
(Superduplex, 6% Mo austenitic, Ni-Cr-Mo alloys where Mo >7%, titanium).

REFERENCES

1. Corrosion Engineering Guide, version 2, Nickel Institute.
2. E. B. Shone, R. E. Malpas and P. Gallagher, Trans. Inst. Mar. Eng. 100 (1988) 193.
3. NORSOK Standard M-001, Rev 4, 2004. "Materials Selection".
4. R. M. Kain, Paper 702, Corrosion '98, San Diego, CA, USA. March 1998, NACE International.
5. J. W. Oldfield and W. H. Sutton, Brit Corr J 13 (197) 13 and 104.
6. T. Rogne and J. M. Drugli and T. Solem, Paper 696, Corrosion '98, San Diego, CA, USA. March 1998, NACE international.
7. T. Rogne and J. M. Drugli. Stainless Steel World '99 Conference. The Hague, Holland, Nov 1999. Published by KCI, page 529.
8. A. Turnbull, Corrosion 55, 2 (1999) 206.
9. F. J. Martin, S. H. Lawrence, P.M. Natishan, E. A. Hogan, K. E. Lucas and E. D. Thomas. Paper 309, Corrosion 2004, New Orleans, LA, USA. March 2004, NACE International.
10. B. Walleen and T Andersson, 10th Scandinavian Corrosion Congress, Stockholm, Sweden, 1986, page 149.
11. R. Francis, Galvanic Corrosion – A Practical Guide for Engineers. Published by NACE International, 2001.
12. R. Francis, "The Selection of Materials for Seawater Cooling Systems – A Practical Guide for Engineers", NACE International, 2006.
13. O. Strandmyr and O. Hagerup. "Field Experience with Stainless Steel Materials in Seawater Systems", Paper No. 707, Corrosion '98, San Diego, CA, USA. NACE International, 1998.
14. S. Shrive. "Seawater Materials – British Experience", presented at Corrosion and Materials Offshore, Stavanger, Norway, January 1999, NITO.
15. C. Amon, R. Howl and J W Oldfield, Paper 332, Corrosion '99, San Antonio, TX, USA. April 1999, NACE International.
16. R. Francis and G. Byrne, Stainless Steel World Vol 16, June 2004, page 53.

TABLE 1
NOMINAL COMPOSITION OF THE HIGH PREN STAINLESS STEELS
SUITABLE FOR USE IN SEAWATER

ALLOY	NOMINAL COMPOSITION (wt%)					
	Fe	Cr	Ni	Mo	N	Others +
Super Austenitic	bal *	20	18 – 25	6	0.2	(Cu)
Super Duplex	bal	25	7	3.5	0.25	(Cu) (W)

bal * = balance
+ = optional elements

TABLE 2
RESULTS OF CREVICE CORROSION TESTS WITH 316L FLANGES
AND VARIOUS GASKETS IN SEAWATER AT ~28°C (REF 4)

Gasket Material	No of Flanges Attacked	Maximum Depth (mm)
Neoprene	0/2	0.00
Butyl Rubber	0/2	0.00
Fluoroelastomer	0/2	0.00
Red – rubber	1/2	0.01
EPDM	1/2	0.05
Nitrile	2/2	0.03
Carbon fibre + nitrile	2/2	0.77
Aramid fibre + nitrile	2/2	2.10
PTFE	2/2	1.05
Glass filled PTFE	1/2	1.40
Graphite/SS	1/2	0.69
PCA *	2/2	0.01

* Perspex crevice assembly (ASTM G78)

TABLE 3
SOME METALS COMMONLY USED FOR SPIRAL GASKETS AND
THEIR COMPATIBILITY WITH HIGH ALLOY STAINLESS STEELS (REF 10)

Alloys Compatible with High Alloy Stainless Steels	Alloys that Should <u>NOT</u> be used with High Alloy Stainless Steels
Superduplex stainless steel	22% Cr duplex stainless steel
6% Mo austenitic stainless steel	Alloy 400
Alloy 625	316 stainless steel
Alloy C-276	317L
Alloy 59	904L
Titanium	Alloy 825
	Alloy 20

TABLE 4
RECOMMENDED MAXIMUM CHLORINE LEVELS FOR SUPERDUPLEX STAINLESS STEEL AT
DIFFERENT SEAWATER TEMPERATURES (REF 14)

Temperature (C°)	Chlorine (mg/l)
10	200
20	5.0
30	1.0
40	0.7

FIGURE 1 Critical crevice temperature at +600mV SCE for 6%Mo stainless steel with various gasket materials (Ref 6)

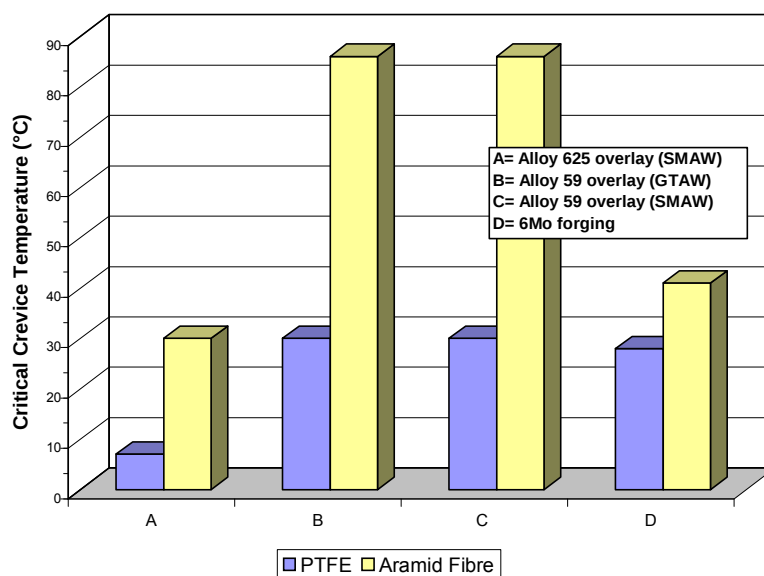
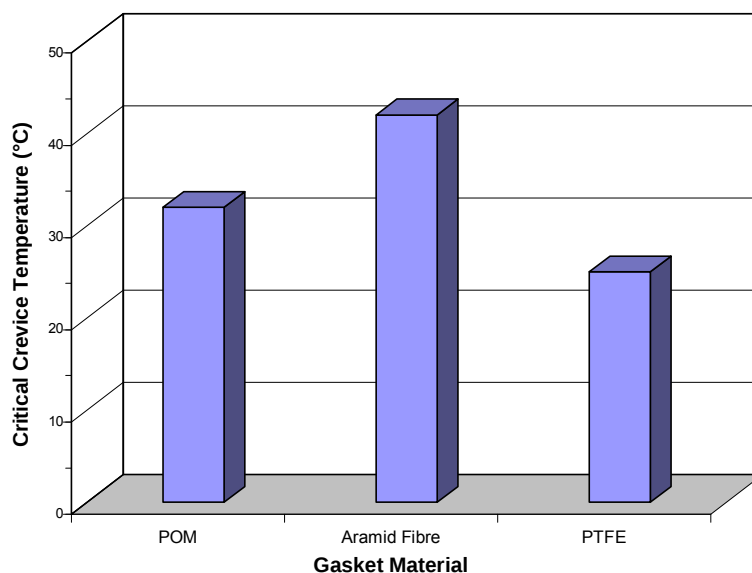


FIGURE 2 Critical crevice temperature at +600mV SCE for 6%Mo stainless steel with different gasket materials (Ref 7)



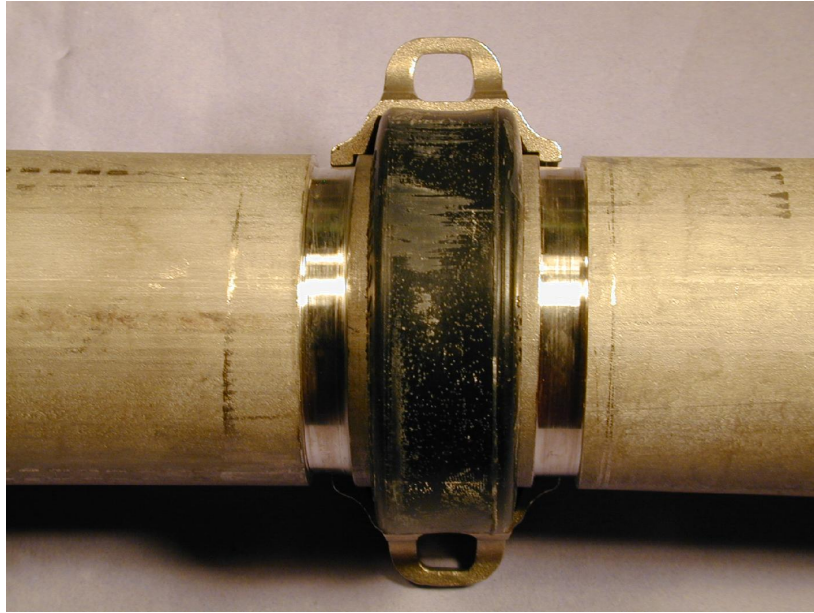


FIGURE 3 - High pressure pipe joint with one half of clamp removed.



FIGURE 4 - Crevice corrosion of 316L at high pressure pipe joint.



FIGURE 5 - Corrosion of a superduplex flange with a graphite-containing gasket.



FIGURE 6 - Corrosion of a superduplex flange with a PTFE coated gasket.



valveIT®

Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com



The client asked for **valveIT support** concerning problems occurred on pneumatic butterfly valves. In details, damages referred to:

- Valve discs suffered from high level of corrosion due to the really hard environment of the Dhuba desalination Plant. Salt, Sand, Humidity, Wind & Sun strongly affected different kind of instrumentation applied on this plant.





valveIT[®]

Via Caduti di Reggio Emilia 27, 40033
Casalecchio di Reno (BO)
www.valveit.com
info@valveit.com



valveIT Intervention:

- After meeting with the client who asked for an urgent help with the occurred issue so as to avoid the plant deadlock, valveIT Technical Staff, basing on its previous experience on desalination project and evaluating on-field chemical and technical data coming from the client's local team, suggested the installation of pneumatic butterfly valves with a disc special coating called "HALAR®" instead of the previously used Rilsan coating. to its technical analysis and support and its prompt response in arranging the halar coated pneumatic butterfly valves, valveIT guaranteed the continuity of operations

